


### TYPICAL CABLE LABELING METHOD

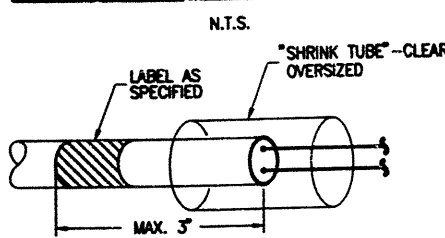


- APPLY LABEL TO OUTER JACKET OF CABLE MAXIMUM OF 3" FROM STRIPPED END AS SHOWN. NOT TO BE COVERED BY OVERSIZED SHRINK TUBE.
- DETAIL APPLIES TO ALL CABLE TYPES


### CIRCUIT LEGEND:

- CIRCUIT DESIGNATION  
CABLE IDENTIFICATION TAG; LIGHT TEXT REPRESENTS EXISTING CABLE TAG TO REMAIN, HEAVY TEXT REPRESENTS THE TAG (BRADY LABEL #WML-305-292 O.A.E.) TO BE FURNISHED & INSTALLED.
- TYPE OF CIRCUIT:
- STR - STROBE CIRCUIT
  - SPK - SPEAKER CIRCUIT
  - ALD - ALD LOOP DEVICE CIRCUIT (EXCEPT SMOKE DETECTOR)
  - TEL - TELEPHONE CIRCUIT
  - SD - SMOKE DETECTOR CIRCUIT
  - WPJ - MAINTENANCE PHONE JACK CIRCUIT
  - WP - WARDEN TELEPHONE CIRCUIT
  - SJ - STAND PIPE PHONE JACK CIRCUIT
- CIRCUIT NUMBER OR NAME:
- A TO G - STROBE OR SPEAKER CIRCUIT NUMBER
  - ATC - CIRCUIT TO ADDRESSABLE TERMINAL STRIP CABINET
  - PS - CIRCUIT TO PULL STATIONS
  - ELEV - CIRCUIT TO ELEVATOR LOBBY AND ELEVATOR
  - HMV - MACHINE ROOM SMOKE DETECTOR
  - IC - CIRCUIT TO OPEN AREA SMOKE DETECTOR
  - IC - INTERFACE CABINET CIRCUIT
  - TIB - TENANT INTERFACE BOX

### TERMINATION LEGEND (EXISTING AND ADDITIONS)

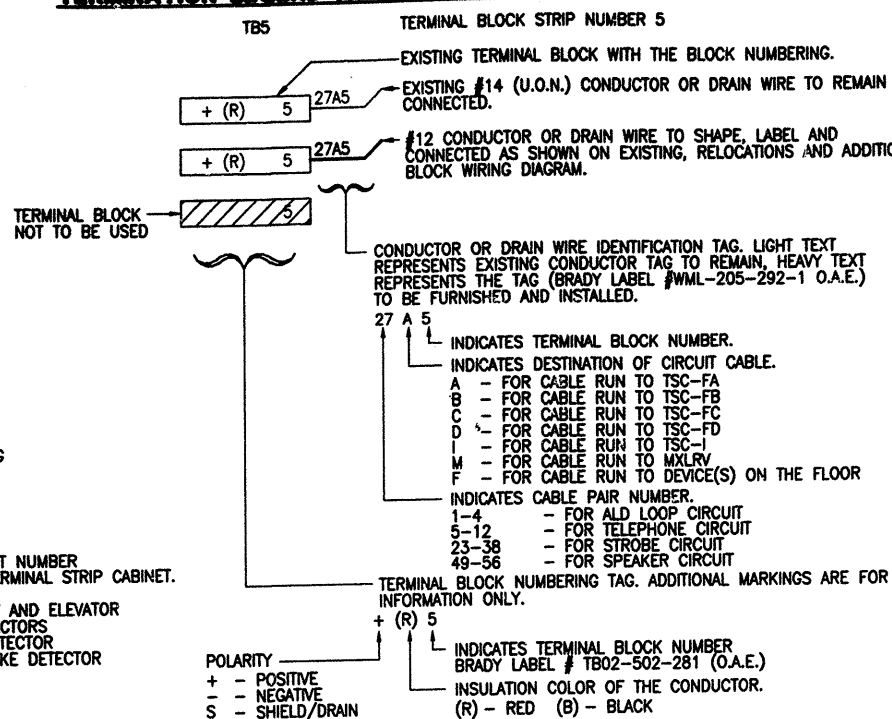

### TYPICAL SHIELD/DRAIN INSULATING METHOD "A"

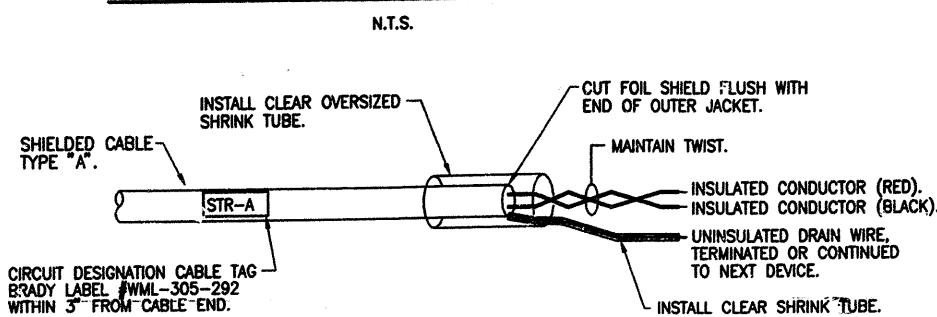

### NOTES:

1. FOR LEGEND, ABBREVIATIONS & GENERAL NOTES, SEE DWG E-1.
2. ALL SHIELDS MUST BE ISOLATED FROM GROUND. APPROVED "SHRINK" TUBING SHALL BE USED ON ALL DRAIN CONDUCTORS. SEE TYPICAL SHIELD/DRAIN INSULATING METHOD "A" ON THIS DWG.
3. ALL WIRING SHALL BE FREE OF GROUND FAULTS, OPENS, SHORTS & STRAY VOLTAGES.
4. ALL WORK SHALL BE DONE IN THE PRESENCE OF THE ENGINEER.

PORT AUTHORITY  
OF NY & NJ

ENGINEERING PROGRAM MANAGER  
CHIEF ELECTRICAL ENGINEER

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS CONSTITUTING A PART OF CONTRACT NO. 146-573 IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.

DATE 2/1/00

DATE 2/1/00

ENGINEERING PROGRAM MGR.

No. Date Revision Approved

ENGINEERING DEPARTMENT

WORLD  
TRADE  
CENTER

ELECTRICAL

Title  
FIRE ALARM SYSTEM  
DEVICE UPGRADE  
PHASE III  
5 WTC 3rd, 4th, 5th & 6th FLOORS

4th FLOOR TSC-FC  
BLOCK WIRING DIAGRAM  
EXISTING AND ADDITIONS


This drawing subject to conditions in Contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

S. FELDSTEIN N. PALACIOS A.S.  
Designed by Drawn by Checked by

NOVEMBER 26, 1999  
Date

WTC-861.573 E-04-8  
Contract Number Drawing Number

### TSC-F-SYSTEM WIRING EXISTING AND ADDITIONS

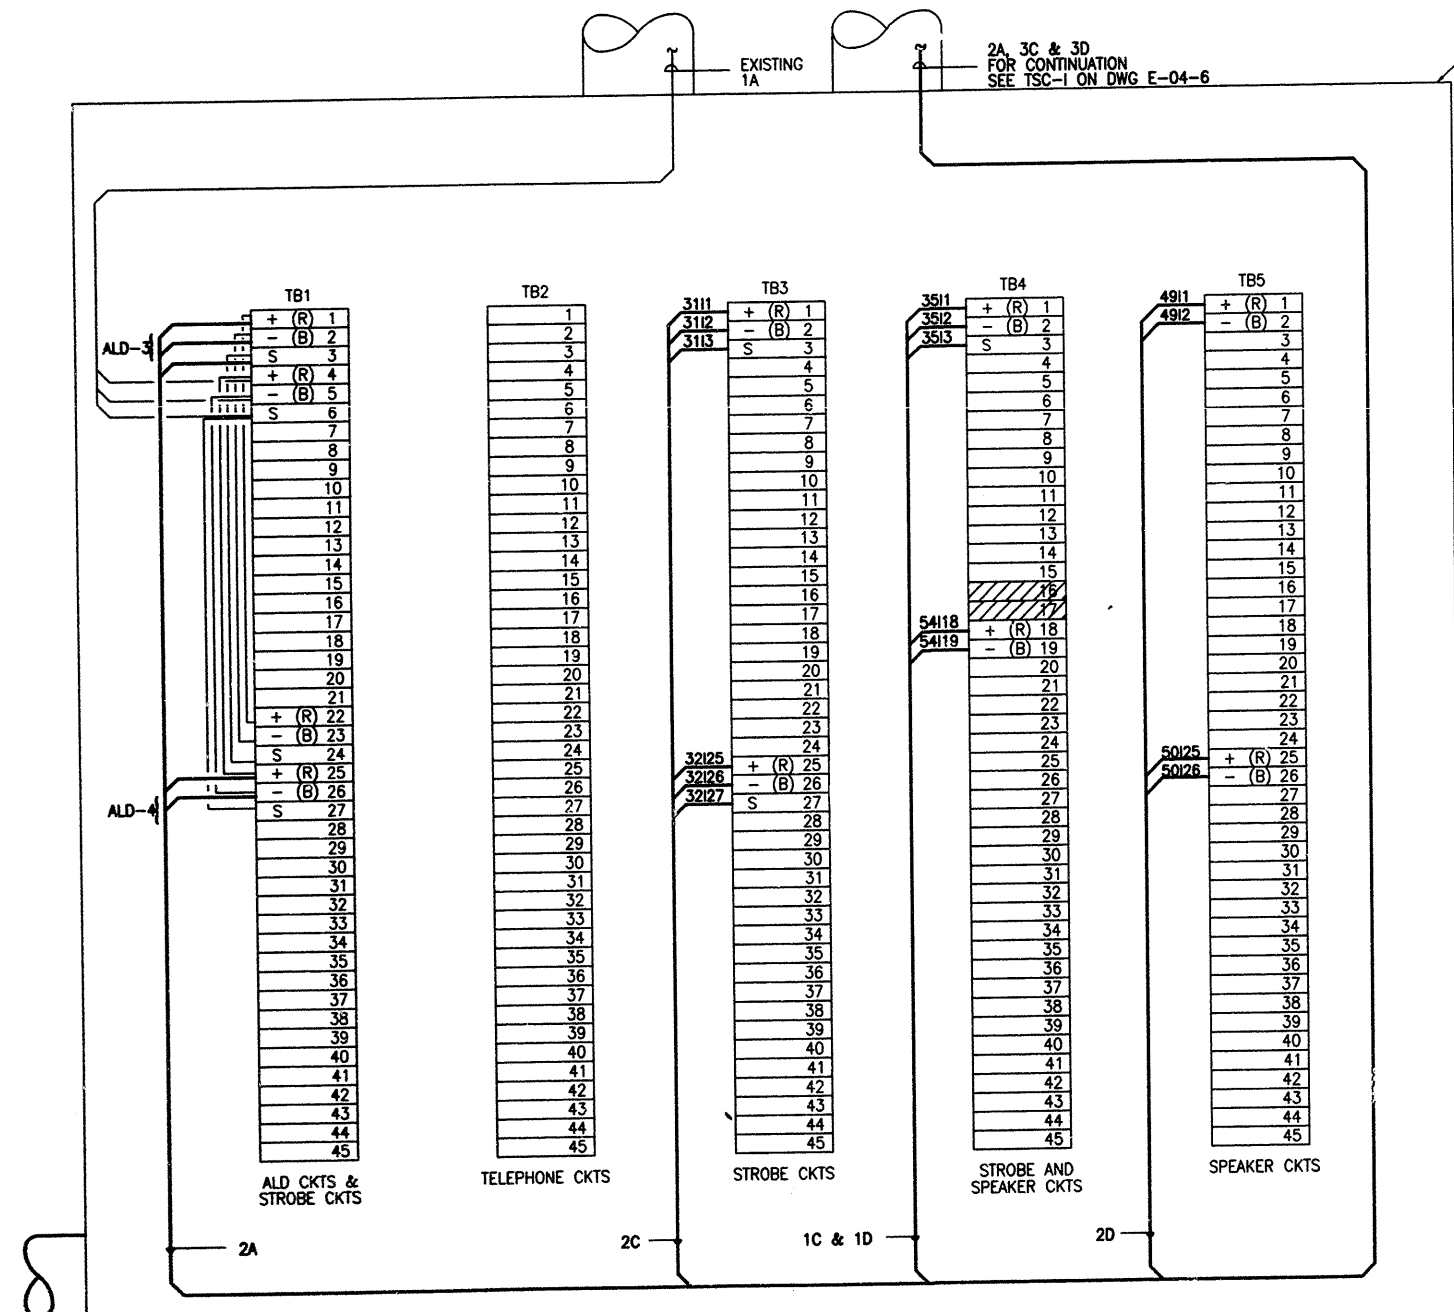

### TSC-F-FIELD WIRING EXISTING AND ADDITIONS

